


# AP-S15IP

## 15A IP LAN Controlled AC Power Distribution & Conditioner with Local & Remote Monitoring

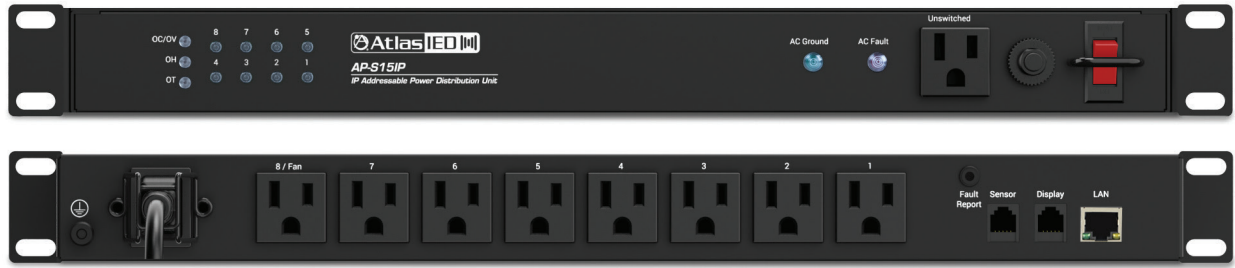

### Features

- 15A Rack Mount Power Conditioner with LAN Network Monitoring & Control
- On-board IP Address Display
- IP Discovery PC Software
- Circuit Breaker Protection @ 15A
- 9 Total AC Outlets
  - 8 Rear Panel Programmable Switched Outlets
  - 1 Front Panel Unswitched Convenience Outlet
- Individual Outlet On / Off Manual Switch and LED Indicator (Enable / Disable)
- Removable 15A IEC Power Cord with Retainer Bracket
- AC Mains RFI Noise Filtering & Surge Protection
- Earth Ground Fault Connection Indicator
- Web User Interface
- DHCP or Static IP Addressable
- Voltage, Current, Temperature and Humidity Monitoring Capability
- Over Voltage, Current, Temperature and Humidity Alarm Setting
- Each Outlet Can be Individually Managed Remotely
- User Definable Names for Each Outlet
- User Definable Delay Time and Sequence
- Temperature Setting for AC Fan Activation
- Fault Log with Reporting
- Fault Reporting GPIO Port
- Password Protection
- Individual Outlet Auto Ping Reset
- User Definable 24 / 7 Schedules of Individual Outlets to Switch Devices On or Off
- 3-Meter Humidity / Temperature Probe
- AP-LEDIP Display Panel Shows Voltage, Current, Temperature, Humidity and IP Address

### Applications

The flexible AP-S15IP was designed with features to be used in a variety of applications. It can be used for AC distribution or for system power and protection against voltage surges or dropouts. The AP-S15IP is ideal for systems that need to be powered On or Off at specific times to conserve energy or to monitor the system for faults and operability. The AP-S15IP can also be used for power conditioning and surge protection. The following are examples of applications where the AP-S15IP can be used:

- Office Buildings
- Restaurants
- Houses of Worship
- Educational Facilities
- Theaters
- Industrial Applications

### General Description

The AP-S15IP is a power conditioner with LAN monitoring & remote control for AC power distribution management. The AP-S15IP features a local display and a web based user interface (UI) that can monitor voltage, current, temperature and humidity. Through the UI, alarms can be set to alert users when a fault condition has occurred via the network UI or Fault contacts. The AP-S15IP's eight rear outlets are programmable and can be scheduled to sequence On / Off individually or in groups on a 24-hour / 7-day schedule. Each AC outlet has a front panel LED status indicator can also be used to manually turn the outlet On or Off. This feature can be disabled via the UI for increased security. A front panel unswitched AC outlet is also included.


The AP-S15IP utilizes the AP-LEDIP remote display to visually show the system's AC power and environmental status, as well as the unit's assigned IP address. The AP-LEDIP can be placed within 10ft of the AP-S15IP. There is also an IP discovery software to help identify AtlasIED IP power strips connected to the network. The AP-LEDIP also provides a visual reference of the voltage, current, temperature or humidity data within the rack in real time. The external temperature / humidity probe monitors rack climate conditions to activate a cooling system if needed. Programmable alarm settings are easily configured with fault logs and fault reporting via the UI. The unit or individual outlets can be tested or monitored for on active status via the network Auto Ping Reset feature.

The AP-S15IP features noise filtering for unwanted Radio Frequency Interference (RFI) that is commonly introduced into AC lines by nearby radio transmitters or wireless products that commonly deteriorate video signals and that can be heard as static in audio signals. Unstable AC Mains voltage is one of the main reasons for equipment failure. The amount of energy that can be injected into the power system can be immense with voltages reaching 6kV or amperage peaks of 3000A. These spikes are very fast and usually only last for a very short period of time. The AP-S15IP's circuitry is very fast and can suppress unwanted energy within a nanosecond response and sustain the suppression up to 2 milliseconds, thus ensuring virtually trouble-free protection. If damage to the suppression circuitry occurs, the AC fault LED will illuminate. The AP-S15IP is designed to allow the installer to select the power cord length that is required for the installation. A removable 2m, 14-gauge IEC power cord with a retainer bracket is supplied with the unit.

The AP-S15IP is designed to be rack mounted into full width racks using 19" (1RU) space.

©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATS005990 RevE 8/21

# AP-S15IP System Diagram Example

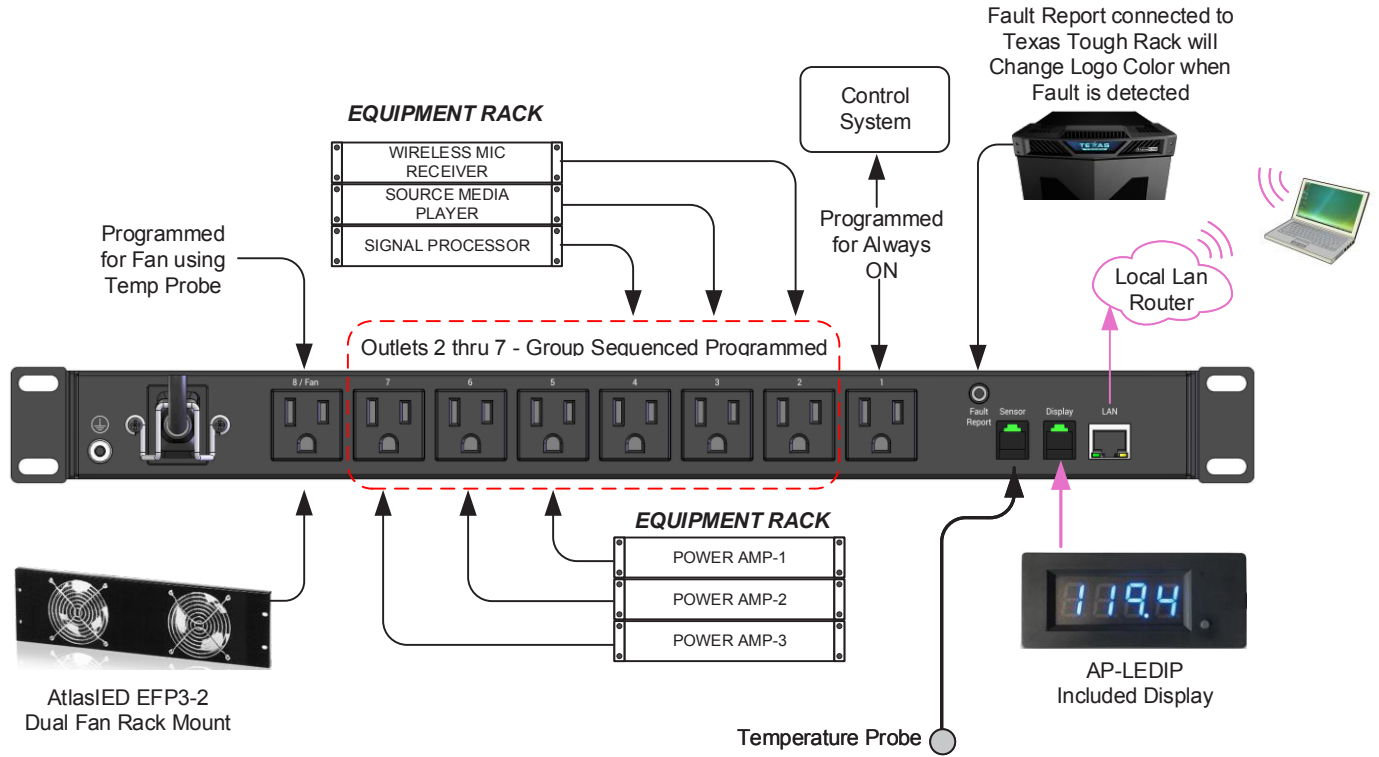

©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas Sound are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATSO05990 RevE 8/21

## Atlas IED IP Power Strip Interface

Welcome, Admin

### AC Outlets Sequence ON/OFF

- Status
- Alarm
- Scheduler
- Network Settings
- Configuration

Temperature 73.7° Humidity 51.0% Voltage 113.2V Current 0.0A

Status

Panel Outlet On/Off Switches	<input checked="" type="checkbox"/> Enable
Device Type	AP-S15IP
Unit Name	AP-S15IP
Grouped Outlets	<input checked="" type="checkbox"/> Enable
Watts	0.00W
Temperature Alarm	<input type="checkbox"/> Enable
Humidity Alarm	<input type="checkbox"/> Enable
Current Alarm	<input type="checkbox"/> Enable
Voltage Alarm	<input checked="" type="checkbox"/> Enable
Incoming AC Mains Spike Protection	<input checked="" type="checkbox"/> Enable

NOTE: When Green, protection is OK. When Red service is required.

Firmware Version FW\_AP-S15IP\_v1.05\_121918.a.bin

Outlet Status & Manual On/Off

Outlet 1	<input checked="" type="checkbox"/> On
Outlet 2	<input checked="" type="checkbox"/> On
Outlet 3	<input checked="" type="checkbox"/> On
Outlet 4	<input checked="" type="checkbox"/> On
Outlet 5	<input checked="" type="checkbox"/> On
Outlet 6	<input checked="" type="checkbox"/> On
Outlet 7	<input checked="" type="checkbox"/> On
Outlet 8	<input checked="" type="checkbox"/> On

NOTE: Individual outlets can be turned ON / OFF by selecting them. When the Power is reset, the group programming will apply if enabled.

## Atlas IED IP Power Strip Interface

Welcome, Admin

### Alarm

- Status
- Alarm
- Scheduler
- Network Settings
- Configuration

Temp Alarm	<input checked="" type="checkbox"/> Enable	Temperature (°F)	100	<input type="button" value="Save"/>
Humidity Alarm	<input checked="" type="checkbox"/> Enable	Humidity (%)	80	
Current Alarm	<input checked="" type="checkbox"/> Enable	Current (A) Average Current	15	
Voltage Alarm		Over Voltage (V)	132	
		Under Voltage (V)	88	
Voltage Alarm Recovery	<input checked="" type="radio"/> Auto Recover <input type="radio"/> Manual Reset			

NOTE: When the voltage alarm is enabled and the over or under voltage settings is reached, the AC Outlets will shut OFF. If Auto Recover is selected, the unit will turn back ON when the voltage is stabilized. If Manual Reset is selected, the power switch will need to be manually reset once the voltage is stabilized.

Alarm Activation Log

2019/05/29/13:38:03-Curr
2019/05/29/13:33:10-Temp
2019/05/29/13:32:27-Humi
2019/05/29/13:30:11-Humi
2019/05/29/13:27:25-Temp
2019/05/28/16:31:31-Temp
2019/05/28/16:27:23-Temp
2019/05/28/16:21:41-Lvov
2019/05/28/16:20:14-Lvov
2019/05/28/16:19:07-Hvov

©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas Sound are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATSO05990 RevE 8/21

### IP Power Strip Interface - Scheduler

Welcome, Admin

Status

Alarm

Scheduler

Network Settings

Configuration

Day/Time NTP: 6/6/2019 14:25:59

Time Zone: Pacific

Daylight Savings:  Enable

NTP Server:  Enable  
52.41.144.197

Group Outlets Schedule (Sequenced):  Enable

Enter 24Hr Clock Settings: On 00:00 Off 00:00

Weekday	M	T	W	TH	F	SA	SU
On	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Individual Outlet Scheduled Time

Enable

Outlet	On	Off	M	T	W	TH	F	SA	SU
Outlet 1	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outlet 2	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outlet 3	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outlet 4	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outlet 5	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outlet 6	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outlet 7	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outlet 8	On 00:00	Off 00:00	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

NOTE 1: If the fan control is enabled, outlet 8 cannot be assigned to the group setting.  
NOTE 2: If an outlet is assigned to a group setting, individual outlet schedule cannot be used.

Save

### IP Power Strip Interface - Network Settings

Welcome, Admin

Status

Alarm

Scheduler

Network Settings

Configuration

Network Interface

Host IP Setting:  Static  DHCP

Static IP: 192.168.1.147

Mask: 255.255.255.0

Gateway: 192.168.1.254

Auto Ping Reset

Outlet	IP Address	Reset
Outlet 1	0.0.0.0	<input type="checkbox"/>
Outlet 2	0.0.0.0	<input type="checkbox"/>
Outlet 3	0.0.0.0	<input type="checkbox"/>
Outlet 4	0.0.0.0	<input type="checkbox"/>
Outlet 5	0.0.0.0	<input type="checkbox"/>
Outlet 6	0.0.0.0	<input type="checkbox"/>
Outlet 7	0.0.0.0	<input type="checkbox"/>
Outlet 8	0.0.0.0	<input type="checkbox"/>

Auto Ping Intervals (min.): 30

NOTE: If the device that is plugged into Outlet 1-8 has an IP address and is on the same LAN as the AC power strip, the device address can be added to the output IP address section above. A ping will be sent to the unit to verify device connection to the LAN. If the device does not respond, the specific outlet will be recycled.

Password

Admin Password: \*\*\*\*\*

Save

Atlas IED **IP Power Strip Interface**

Welcome, Admin

Status

Alarm

Scheduler

Network Settings

Configuration

### Configuration

**Function** Save

Panel Outlet On/Off Switches  Enable

AC Fan Control Setting (Outlet 8)  Enable NOTE: When enabled Outlet 8 cannot be assigned to a group or schedule.

Fan On Temp (\*F)

Fan Off Temp (\*F)

Sequence Delay Time (sec)

External Meter AP-LEDIP Display View

Temperature Reading F / C

**Group Management** Save

	Group Assignment
Outlet 1	<input checked="" type="checkbox"/> Assign
Outlet 2	<input checked="" type="checkbox"/> Assign
Outlet 3	<input checked="" type="checkbox"/> Assign
Outlet 4	<input checked="" type="checkbox"/> Assign
Outlet 5	<input checked="" type="checkbox"/> Assign
Outlet 6	<input checked="" type="checkbox"/> Assign
Outlet 7	<input checked="" type="checkbox"/> Assign
Outlet 8	<input checked="" type="checkbox"/> Assign

NOTE: If the fan control is enabled, outlet 8 cannot be assigned to the group setting.


NOTE: If an outlet is assigned to a group setting, individual outlet schedule will be removed.

**Unit & Outlet Name** Save

Unit Name

©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas Sound are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATSO05990 RevE 8/21

## Dimensional Drawings

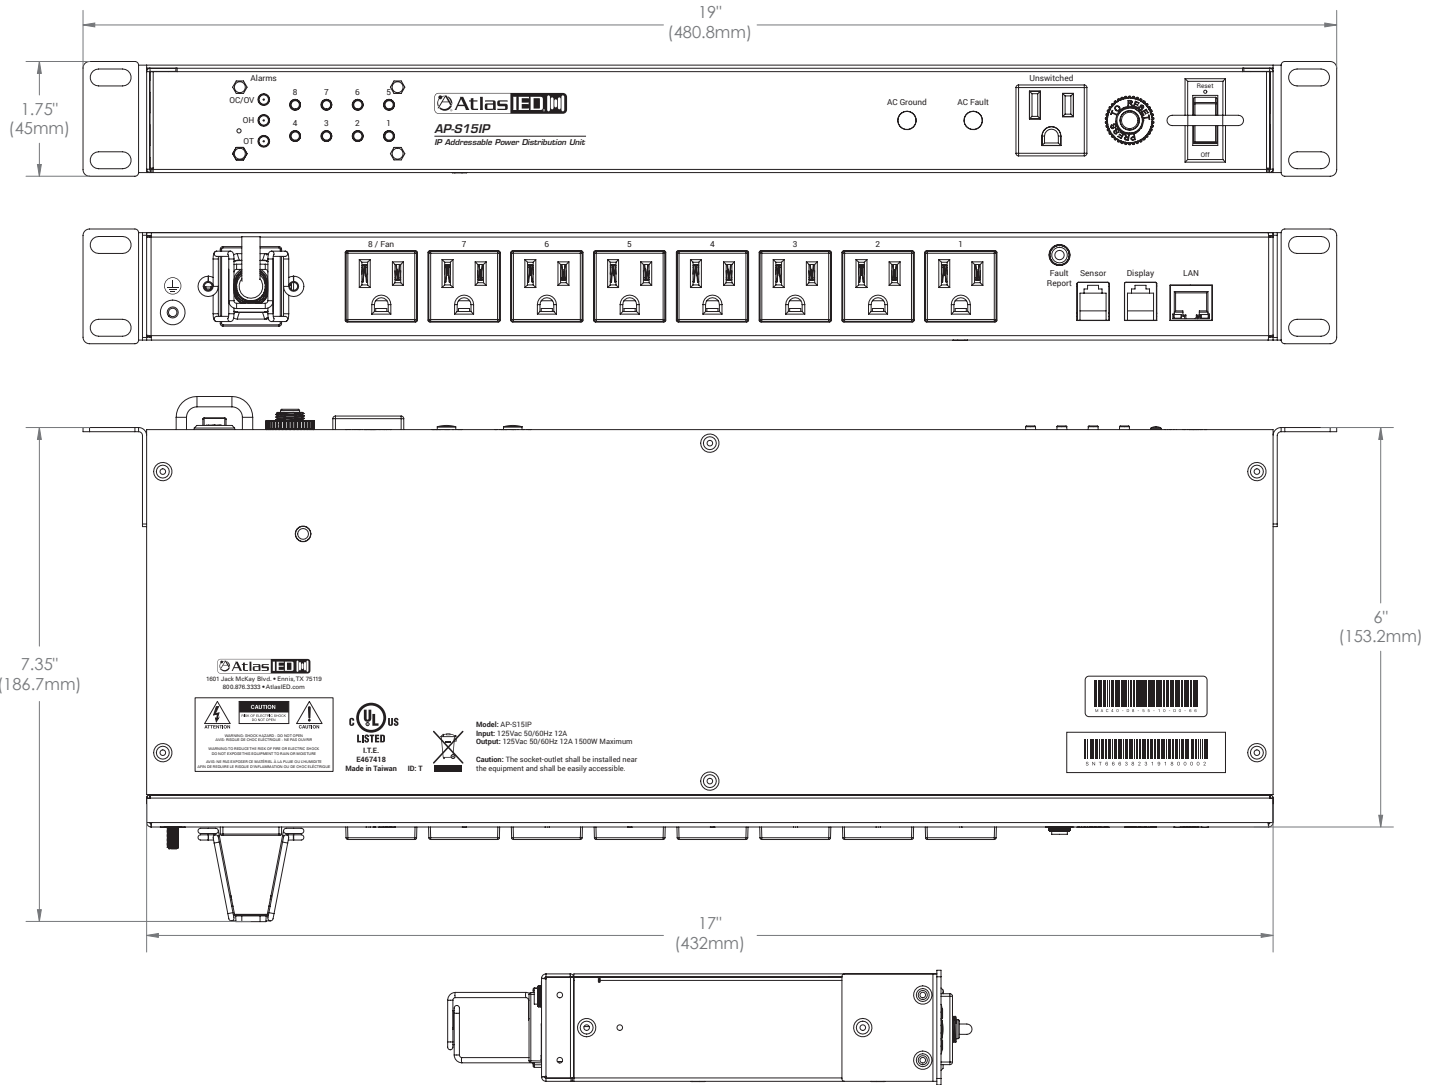

©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas Sound are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATIS005990 RevE 8/21

## AP-LEDIP

This remote magnetic data display comes with a 10ft cable so it can be placed on the rack where data viewing is preferred. This display can show AC mains voltage, current, rack temperature and humidity. The preferred data value to be shown can be set in the WEB interface. The other readings can be accessed by pressing the data display viewing switch located on the front of the display. One of the main features is the display of the IP address assigned to the power strip. Press and hold the data display viewing button and the assigned IP address will scroll.



©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas Sound are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATSO05990 RevE 8/21



System	
Type	Networked AC Power Distribution Conditioner & Suppressor
Load Rating	Max Load 15A (1800W), Rated Load 12A (1440W)
Network Type	LAN (Local Area Network) (Note 1)
Front Panel	
Activation Switch	Rocker with Security Bar
Circuit Breaker	15A Resettable Power Switch
Outlet On / Off Switches	Momentary Manual
AC Outlets	NEMA5-15R Unswitched, Qty 1
Front Panel Indicators	
Power On Indicator	Power Switch LED, Red
Outlet Status Indicators	Green, Qty 8
Over Temperature Alarm Indicator	Red, Programmable Range 50° - 176°F , 10° - 80°C
Over Humidity Alarm Indicator	Red, Programmable Range 15 - 95%
Over Current / Voltage Alarm Indicator	Red, Programmable Range High - Voltage 100V - 140V, Under Voltage 80V- 120V
AC Fault Indicator	Red, Illuminates When Surge Protection is Damaged
AC Ground Indicator	Red, Illuminates When Earth Ground Is Bad
Rear Panel	
AC Outlets	NEMA5-15R Switched (Programmable), Qty 8 <b>Note:</b> Outlet 8 Can Be Used to Activate a Fan Triggered by Temperature Range of On: 51° - 176°F / Off: 50° - 175°F
AC Mains IEC Power Socket	IEC NEMA 5-15P 15A 1800W with Power Cord Retainer
LAN Port	RJ45, Ethernet Port
Temp / Humidity Port	RJ14, Temperature, Humidity Probe, 2M, Probe Included
Display Port	RJ25, for AP-LEDIP Display for Voltage, Current, Temperature, Humidity, IP Address
Fault Report Port	3.5mm Jack, Fault Reporting Contact Closure, Normally Closed & Opens During Fault State, Cable Included
GPIO Fault Relay Port	Fault Relay Interface, Temperature, Humidity, Over & Under Voltage, Over Current, Surge, Cable Included
User Interface and Configuration	
WEB Interface	HTTP Protocol, XML Commands Available
Status	Voltage, Current, Temperature, Humidity, Spike Protection, Ground Fault, Outlet Status
Alarms	Voltage Hi / Lo, Current, System Temperature, Humidity, Fault Log
Scheduler	24 / 7, Group Schedule or Individual Outlet Schedule
Network Settings	DHCP (default) or Static IP, Individual Outlet Auto Ping Reset (Note 1)
Sequence Delay	One Setting Between Outlets, 1 Second - 99 Seconds
System Configuration	Outlet Naming, Group Assignment, Temperature Activated Outlet
Technical Data	
Max AC Mains Current	12A, 1440W
Operating Voltage	100VAC - 132VAC
Power Consumption	8-Watts
Noise Attenuation RFI	10dB @ 10kHz / 40dB @ 100kHz / 100dB @ 10MHz
Min. Spike Clamping Voltage	460VRMS @ 3,000A
Max. Spike Clamping Voltage	6000V, 1 nanosecond
Spike Clamping Voltage @ 100A	1250Vp for 20µs
Maximum Surge Current	6,500A
Energy Rating @ 2ms	600 Joules
Unit Operating Temperature Range	40° - 105°F, 5° - 40.5°C
Humidity Range	5% to 95% Relative Humidity
Fault Reporting	WEB, GPIO Contact Closure (Closed During Normal Operation, Opens During Fault Condition), API Commands

©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas Sound are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATSO05990 RevE 8/21



Mechanical	
Chassis Finish	Black
Product Dimensions (HxWxD)	1.75' x 19' x 7.35' (45mm x 481mm x 187mm)
Shipping Dimensions (HxWxD)	5' x 18.7' x 10.6' (129mm x 475mm x 269mm)
Unit Weight	5.5 lbs. (2.5kg)
Shipping Weight	7.72 lbs. (3.5kg)
Agency Approvals	
Safety Listing	North America UL1449, UL60950-1, CAN/CSA C22.2 No. 60950-1
Package Contents	
AP-S151P	Qty 1
AP-LEDIP Display	Qty 1
Temperature / Humidity Probe	Qty 1
Fault Interface Probe	Qty 1
2m 14-Gauge IED Power Cord	Qty 1
IEC Power Cord Retailer Bracket	Qty 1

**Note 1:** The AP-S151P meets the Californian law SB-327. Each unit is shipped with a unique password that can be changed for accessing the device over the network. The AP-S151P is a LAN (Local Area Network) device and requires a firewall or VPN for secure connection outside the network operation. AtlasIED recommends consulting an IT specialist for best network security practices before installation.

©2021 Atlas Sound L.P. The Atlas "Circle-A", Soundolier, and Atlas Sound are trademarks of Atlas Sound L.P. IED is a Registered Trademark of Innovative Electronic Designs LLC. All rights reserved. All other Trademarks are property of their respective owners. No endorsement is implied. Due to continual product development, specifications are subject to change without notice. ATSO05990 RevE 8/21

## Architect and Engineer Specifications

The AtlasIED power conditioner and surge protector with LAN monitoring & remote control shall be AtlasIED model AP-S15IP. The AP-S15IP shall provide up to 1440-Watts of 120V AC power to a total of 9 AC outlets: 8 rear programmable panel outlets and 1 front panel unswitched outlet.

The AP-S15IP shall have a web based user interface (UI). Each unit shall ship with a unique password for accessing a network to comply with the California law SB-327. The AP-S15IP shall monitor voltage, current, plus temperature and humidity via an external probe. The AP-S15IP shall have alarms set to alert users when a fault condition has occurred via the network UI or via the rear fault contacts. The AP-S15IP shall have the ability to program a scheduler to sequence outlet activation as a group or individually. Sequence On/Off delay between outlets shall be adjustable from 1 to 99secs.

The AP-S15IP shall utilize PC based IP discovery software to identify a unit IP address within a LAN. The assigned IP address is also shown via the included AP-LEDIP remote display. Voltage, current, temperature or humidity shall be monitored via the UI. The external temperature / humidity probe shall measure the rack climate conditions to activate a cooling system if needed. Each outlet shall be tested or monitored for active status via a network Auto Ping Reset feature.

The AP-S15IP shall feature noise filtering for unwanted Radio Frequency Interference (RFI). The unit shall have circuit breaker protection at 15A. The AP-S15IP front panel shall include AC Ground, AC Fault and Outlets Active indicators and protective security bar over power switch. Finish shall be textured black epoxy and dimensions shall be 1.75"H x 19"W x 7.35"D (45mm x 481mm x 187mm) to mount into 1RU of space. The AP-S15IP shall come with removable rack ears.

The AP-S15IP complies with UL1449, UL60950-1 and CAN/CSA C22.2 No. 60950-1.

The AtlasIED power conditioner with LAN monitoring & remote control shall be the AP-S15IP.