


FC104T72

Speaker Transformer Wiring Diagram

Model #	Frequency Response	Sensitivity
FC104T72	150Hz-17kHz	94dB (1W/1M)

Transformer Wiring Diagrams

Installation must comply with all Building Codes and NFPA guidelines. Installation must adhere to N.E.C. and NFPA 70/72 wiring directives and comply with all National and Local Building Codes.

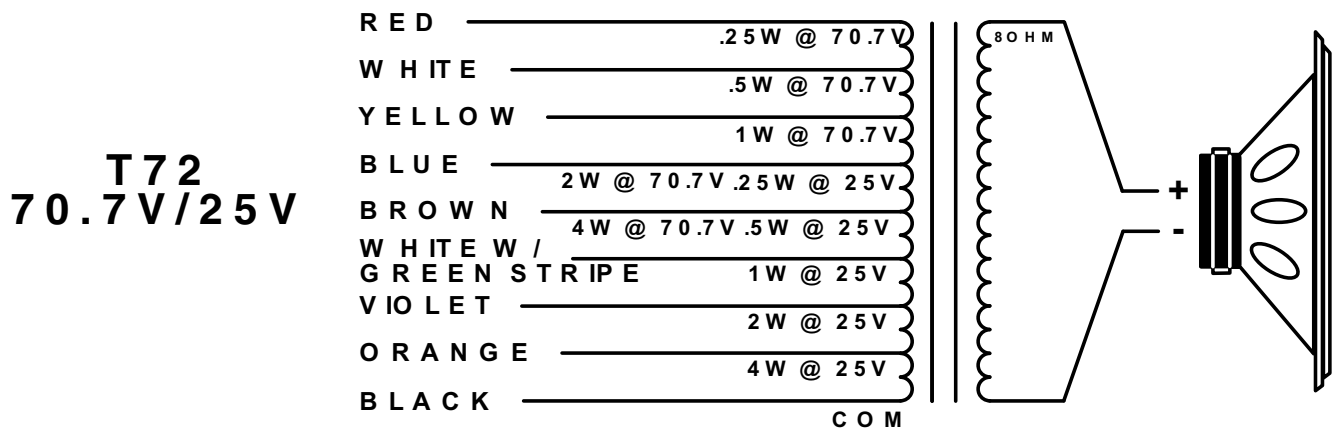

To conform with applicable UL standards speaker must be installed with
UL Listed Baffles: 51-4 and with UL Listed Enclosures: 96-4, 96-4X